

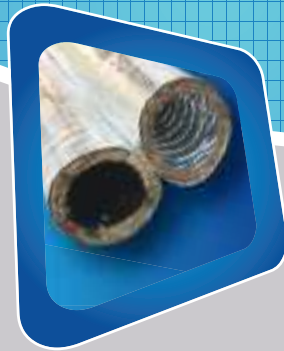


# AERODUCT

## Ducting Accessories

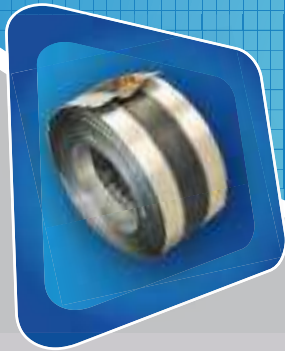

The Most Comprehensive Range of Ducting Accessories

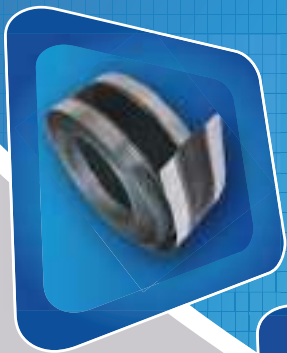



## MILD STEEL ZINC PROTECTED

**Model: ADGSB 09-6-30**

Aeroduct Stranglehold Banding are zinc protected mild steel. This is most popular clip in our range. Ideally suited for most day requirements for joining hose in areas such as the HVAC industry and the automotive aftermarket, agricultural application, such as irrigation and farm machinery, pneumatic and hydraulic application in the industrial sector, hardware/DIY applications and in construction.

**Thickness: = 0.6 mm, Width: 9 mm**


## STAINLESS STEEL AISI430ss

**Model: ADSSB 09-6-30**


The most versatile of clips in the Aeroduct Stranglehold Banding range, our Original Range Aeroduct Banding in 304 (18/8) stainless steel are widely used across all industries where hose clips are used to secure hoses, as well as for other applications. Their corrosion resistance enables their use in the marine, oil and gas and food sectors, as well as the agricultural, hardware and industrial sectors, where higher corrosion resistance is required.

# RECOMMENDED INSTALLATION PROCEDURE


## CONNECTIONS

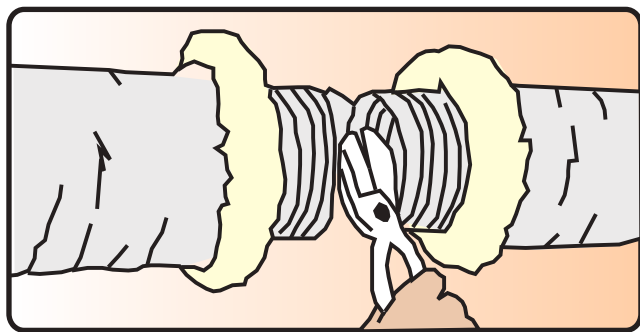

Cut completely around and through the duct with knife or scissors. Cut the wire with wire cutters. Fold back the jacket and insulation

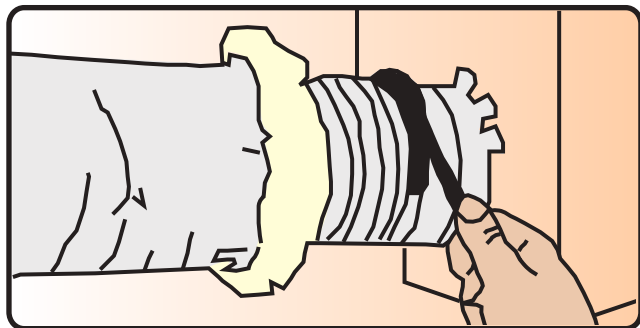

Slide at least 1" (25mm) of core over fitting and past the bead. Seal core to cover with 2 wraps of duct tape. Secure the connection with Aeroduct clamp placed over the core and tape and past the bead.

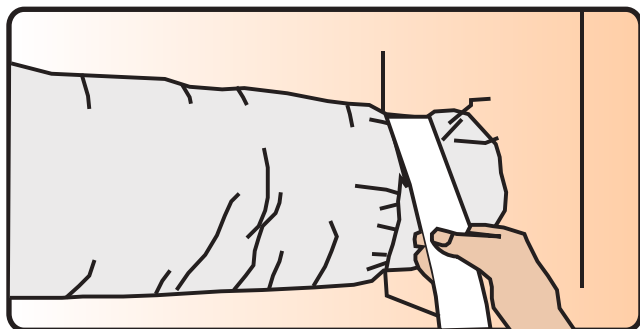


Pull jacket and insulation back over the core. Use at least 2 wraps of duct tape to tape the jacket. You may use a clamp along with or instead of the duct tape.


### Precautions during installation:

Aeroduct insulated ducts use fibreglass insulation which is classified as a possible cancer hazard by inhalation. In addition fibreglass insulation may cause temporary irritation to the eyes and skin. Kindly ensure that protective clothing, face mask and gloves are used while handling or installing the flexible ducts. Wash hands properly with soap and water after use.


## SPLICES

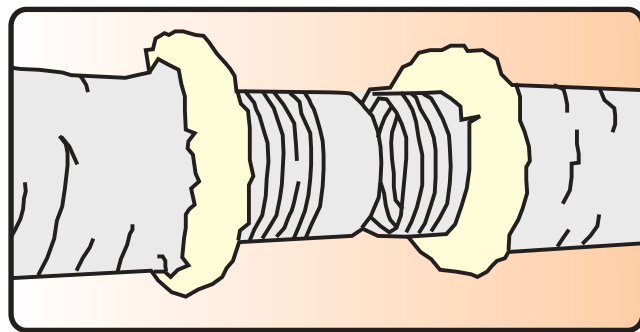

Fold back jacket and insulation from core. Butt 2 cores together on a standard 4" (100mm) length metal sleeve.

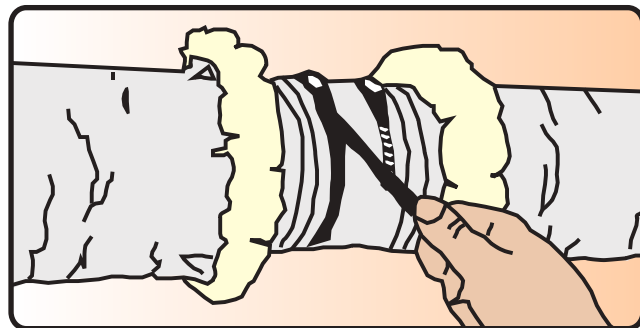

Use at least 2 wraps of duct tape to tape the jacket. Secure the connection with Aeroduct clamp placed over the core and tape and past the bead.

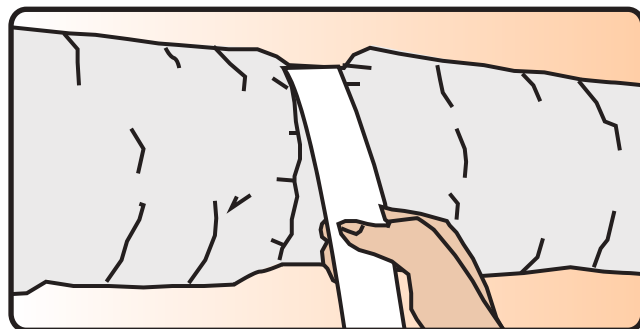

Pull jacket and insulation back over cores. Use at least 2 wraps of duct tape to tape the jacket.





**MANILA BAY RESORT, PHILIPPINES**



**BLUE WATER DUBAI PROJECT**



**HARTLAND GREEN – SOBHA, DUBAI - UAE**



**ABU DHABI INTERNATIONAL AIRPORT 1**



**COLOMBO CITY CENTRE, SRI LANKA**



# PROJECTS



**OMANTEL HEADQUARTER**



**BAHRAIN AIRPORT PROJECT**



**REEM MALL, ABU DHABI, UAE**



**DUBAI PARKS AND RESORTS**



**PALM TOWER PROJECT**



**MARINA GATE TOWER, DUBAI - UAE**

# CERTIFICATE OF REGISTRATION

This is to certify that the management system of:

## Hira Industries LLC

Main Site: Plot No 118 to 123, 307, 309 & 311, Al Ghail Industrial Park –  
RAKEZ, P.O. Box 9013, Ras Al Khaimah, United Arab Emirates

has been registered by Intertek as conforming to the requirements of:

## ISO 9001:2015

The management system is applicable to:

Manufacture of Molded & Extruded Rubber Products, Ducting  
Accessories, Smoke and Fire Curtains, Pipe Support Systems, Adhesive  
Tapes and Aerofoam Closed Cell Polyolefin & Elastomeric Insulation  
Products.

**Certificate Number:**

0112982

**Initial Certification Date:**

07 May 2018

**Date of Certification Decision:**

28 June 2022

**Issuing Date:**

28 June 2022

**Valid Until:**

06 May 2024



**Calin Moldovean**

President, Business Assurance

Intertek Certification Limited, 10A Victory Park,  
Victory Road, Derby DE24 8ZF, United Kingdom

Intertek Certification Limited is a UKAS  
accredited body under schedule of  
accreditation no. 014.



# AERODUCT

Ducting Accessories



**Manufactured By: Hira Industries LLC (AERODUCT DIVISION)**

P.O.Box: 113462, Dubai - U.A.E.

Tel : +971 4 884 8414

Fax : +971 4 884 8434

Email: [enquiry@rhira.com](mailto:enquiry@rhira.com)

[www.rhira.com](http://www.rhira.com)

## **U.A.E.**

Dubai (Showroom)

Tel : +971 4 2288988

Fax : +971 4 2233983

Abu Dhabi

Tel : +971 2 6347815

Fax : +971 2 6347825

## **Qatar**

P.O.Box 31179,

Doha - State of Qatar

Tel : +974 4467 6046 / 4779

Fax : +974 4467 3514

## **Kuwait**

Tel : +965 60046670

## **Oman**

P.O.Box 167, P.C.102, Sultanate of Oman

Tel : +968 2449 5919/+968 92591004

Fax : +968 2449 6649

## **Saudi Arabia**

Riyadh:

Tel/Fax: +966 1 14631749

Jeddah:

Tel: +966 56 9393148

## **India**

HIRA HVAC Tradelinks Pvt. Ltd.

Unit No.103/104, City Industrial Estate

Ground Floor, Vasai Phata, Vasai (E)

Dist Thane (Maharashtra), India - 401208

Tel : +91 250 321 1963 / 64 / 65

## **Sri Lanka**

Tel:+94 7737 10104

## **Australia**

Tel:+614 09 646 747

[www.aeroduct.ae](http://www.aeroduct.ae)